




Republic of the Philippines  
Department of Agriculture

**SUGAR REGULATORY ADMINISTRATION**

Sugar Center Bldg., North Avenue, Diliman, Quezon City, Philippines 1101  
TIN 000-784-336  
Website: <http://www.sra.gov.ph>  
Email Address: [srahead@sra.gov.ph](mailto:srahead@sra.gov.ph)  
Tel No. (632) 8929-3633, (632) 3455-2135, (632) 3455-3376

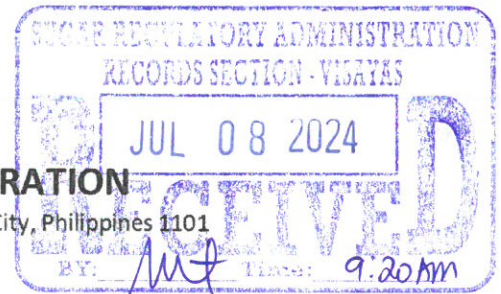

**SUPPLEMENTAL/BID BULLETIN NO. 1**  
**Rehabilitation of SRA Balay OPSI**  
**Bid Reference No. 2024-COB-05**

With reference to the Bidding Documents for the Rehabilitation of SRA Balay OPSI, posted at the PhilGEPS and SRA websites, this Supplemental/Bid Bulletin is being issued after having conferred with the Technical Working Group and the Provisional Member/End-user Representative, to clarify, amend, and modify some items in the provisions of the Bidding Documents, in response to the recommendations raised by prospective bidders, as follows:

Section I. Invitation to Bid			
From		To	
	INVITATION TO BID FOR REHABILITATION OF SRA BALAY OPSI (2023-COB-05)		INVITATION TO BID FOR REHABILITATION OF SRA BALAY OPSI <b>(2024-COB-05)</b>

Section III. Bid Data Sheet			
From		To	
ITB Clause 5.2	For this purpose, contracts similar to the Project refer to contracts which have the same major categories of work, which shall be:  The contracts similar to the projects are, as follows:  Vertical Infrastructure Projects	ITB Clause 5.2	For this purpose, contracts similar to the Project refer to contracts which have the same major categories of work, which shall be:  The contracts similar to the projects are, as follows:  Vertical Infrastructure Projects, <b>such as construction/repair/renovation/rehabilitation of a building.</b>

Section VI. Specifications			
TECHNICAL SPECIFICATIONS AND GENERAL REQUIREMENTS			
From		To	
	<b>CEILING WORKS</b> Interior ceiling shall be of 3.5mm thick Hardiflex board with 25mm x 50mm x 0.40mm thick metal furring rest on a 1" x 1" G.I. wall angle at the perimeter of the wall. Provide a hanger at every joint of the joist for sagging on center for horizontal and vertical.		<b>CEILING WORKS</b> Interior ceiling shall be of <b>4.5mm</b> thick Hardiflex board with 25mm x 50mm x 0.40mm thick metal furring rest on a 1" x 1" G.I. wall angle at the perimeter of the wall. Provide a hanger at every joint the joist for sagging on center for horizontal and vertical.

The Supplemental/Bid Bulletin No. 1 shall form part of the Bidding Documents. Any provisions in the Bidding Documents inconsistent herewith is hereby amended, modified and superseded accordingly.



SUGAR REGULATORY ADMINISTRATION  
HUMAN RESOURCE & RECORDS SECTION  
DOCUMENT ARCHIVING SYSTEM  
SRA-VIS-1116270



Management System  
ISO 9001:2015  
[www.tuv.com](http://www.tuv.com)  
ID 910508557



For the guidance and information of all concerned.

Issued this 8<sup>th</sup> day of July 2024.



**ATTY. GUILLERMO C. TEJIDA III**  
Chairperson, Regional Bids and Awards Committee